

## Prevent type 2 opt-out code use in TPP SystemOne – detained and secure estates

Published 7 March 2019

Type 2 opt-out codes (CTV3 codes XaaVL / XaaVM) are no longer valid, because the national data opt-out has replaced type 2 opt-outs. You should make sure they are not being used to record patient choices on use of their data for research and planning.

The codes have been marked as non-recommended in the SystemOne Read Code Browser. This stops them being added to a patient record directly through the browser.

However, the codes could still be added to records if they are still included in a template, so you must check your templates to remove these codes and prevent their use.

If a user selects an invalid code from within a template, it will be added to the patient record with no warning or pop-up.


You should also audit patient records to check whether any opt-out codes have been added in error since collection of type 2 opt-outs ended on 11 October 2018.

For the most up-to-date guidance and more resources, including copies of letters, visit <https://digital.nhs.uk/services/national-data-opt-out-programme/information-for-gp-practices>

**Information and technology**  
**for better health and care**

## Check templates

From the Read Code Browser, select the 'Templates' tab. Enter the code XaaVL into the box and click Search.

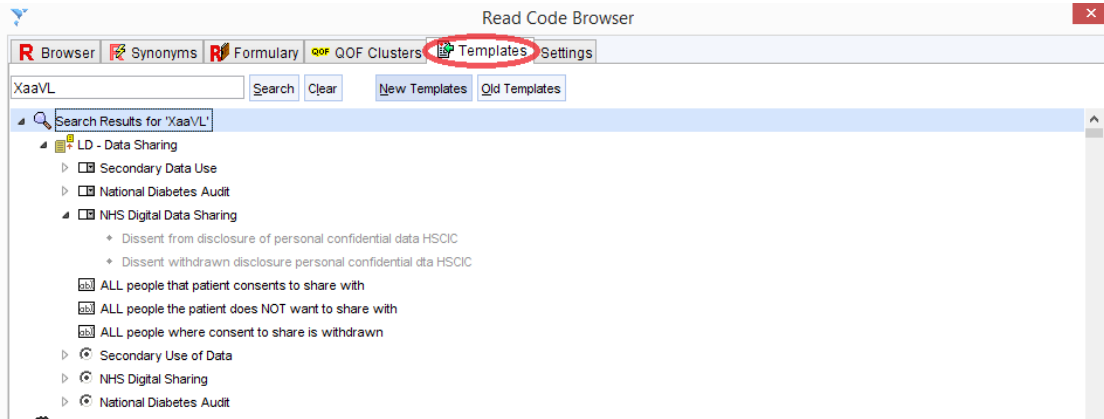


The results will show any templates containing the code, which are published:

- locally (by your organisation)
- across a group that your organisation belongs to
- system-wide by TPP and available to your organisation

## Local templates containing invalid codes

If the search finds local templates, edit them using the New Template Maintenance option to remove the invalid codes.

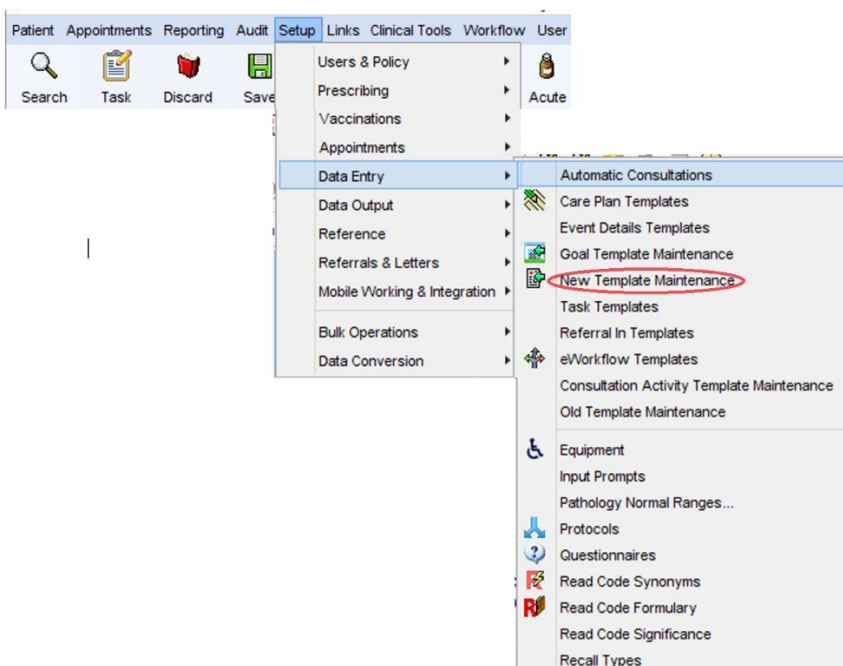


## Other templates containing invalid codes

If the search finds templates published by another organisation, contact the template owner to remove the invalid codes.

## Check other data entry tools

If your organisation uses other data entry tools, such as Automatic Consultations or Protocols, you should check these for use of the invalid codes.

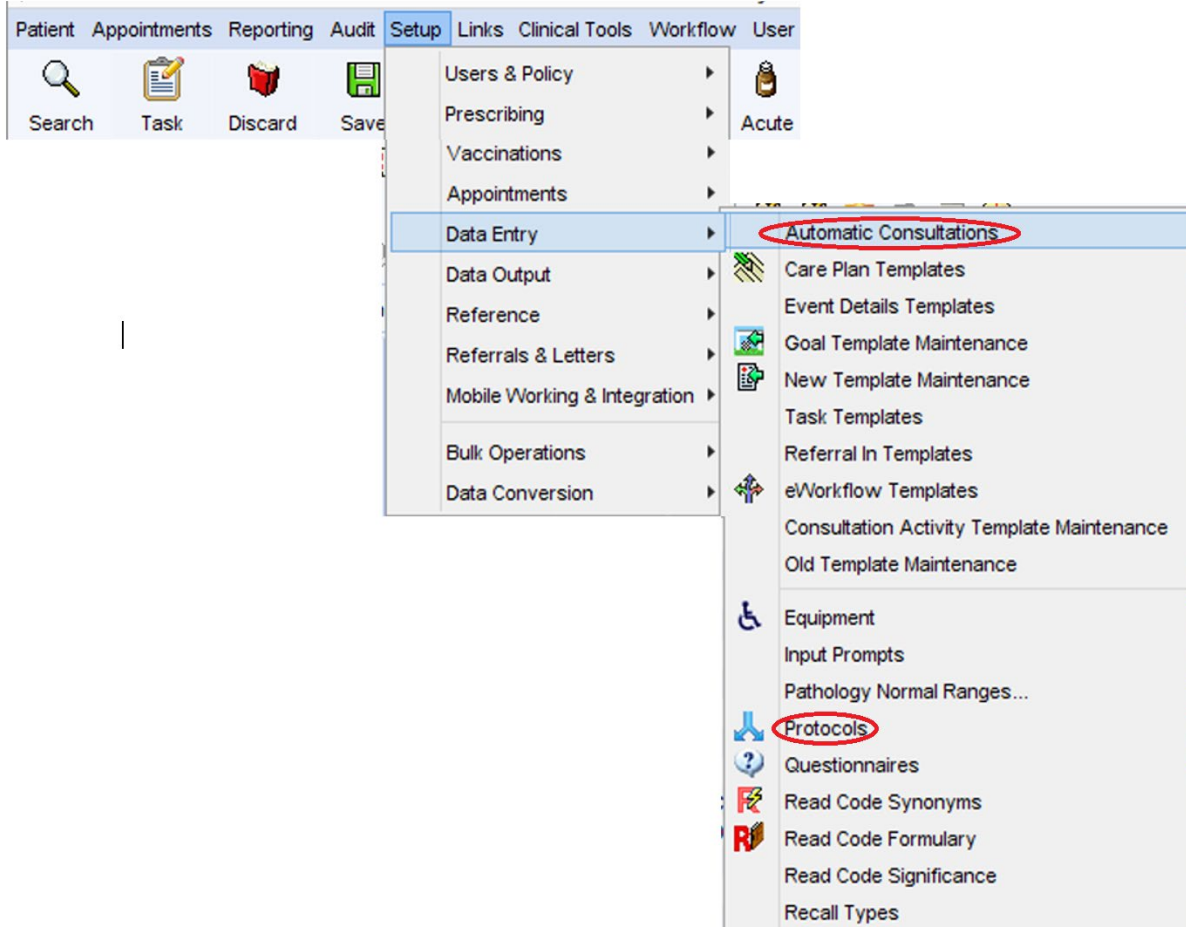

## Support

For further information or queries about SystemOne functionality please contact the TPP helpdesk.